

Client# C1003341SA101

Date: 8-14-2019

Temp 80°

Client Name _____
Address _____

Square Footage 742 Year Built 1988 # Bedrooms 2 # Bathrooms 1

Blower Door 3100 @-50 Target 1113 @-50

Pressure Pans: Return 4.5 Living Room 11.9 Kitchen 11.6 Bedroom 7.5

Bedroom 10.2 Bathroom 10.5 Bedroom _____ Bathroom _____ Other _____

Heat Description: Coleman MFG: 1983 Fuel electric

Model # 3400-815 Serial # 088302159

Efficiency: 53 Kbtu heat is inoperable

Air Conditioning Description: _____

Model # _____ MFG: _____ Serial # _____

Efficiency: _____

Water heater: US Craftmaster E2F40RDS40V Cover plate @ wires V Pipe Needed? Needed

Refrigerator: Hotpoint CTF45CB0 Pot Seal

Existing Insulation: Walls 3" - 2.5" Gmt

Attic 2" blanket

Floor 2.5" below

Vapor Barrier Needed: _____ # Smoke Detectors Needed _____ # CO Needed _____

Bath Window insp Fan CFM Ø Bath Window _____ Fan CFM _____

Kitchen Window yes Fan CFM Ø


Health & Safety Items Needed: _____

Dryer Vent Needed: yes

C1003341SA101

14'

53'

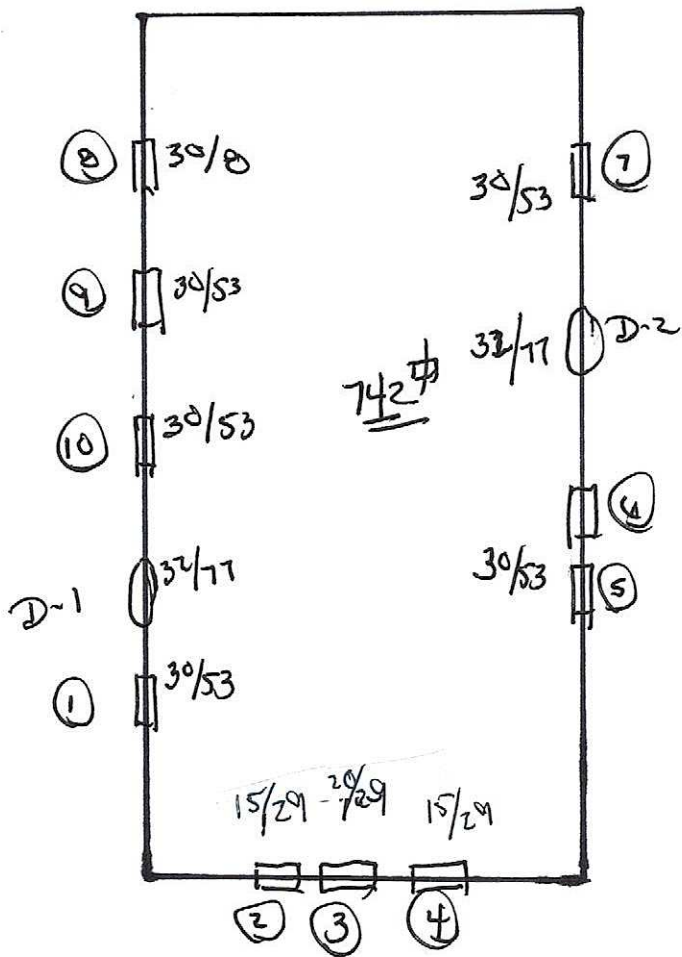

street

