

Client# C1003648 SA101

Date: 1-3-2020

Temp 51°

Client Name _____

Address _____

Square Footage 10.48 1088 Year Built 1984 # Bedrooms 2 # Bathrooms 2

Blower Door 2101 @-50 Target 1088 @-50

Pressure Pans: Return @ unit Living Room 20.5 Kitchen 18.5 Bedroom 14.6

Bedroom 23.4 Bathroom 13.6 Bedroom _____ Bathroom 18.3 Other 108.9/6

US Aluminum MFG Co. - (Goodman)

Heat Description: Split System Heat Pump MFG: 2015 Fuel Electric Nat Gas Propane

Model # AAUF31B14BA Serial # 1509323229

Efficiency: 7.7 * 0.99^4 = 7.2 HSPF

Air Conditioning Description: Goodman - Split System -

Model # VSZ130301AG MFG: 2014 Serial # 1410387134

Efficiency: 13 * 0.99^4 = 12.2 SEER

Water heater: no craftsman EAF40R0035V PRV Pipe Needed? yes

Refrigerator: FGUS2642 LF 1 Frigidaire

Existing Insulation: Walls 3.5" Craft

Attic 3" blanket

Floor ∅ expected

Vapor Barrier Needed: _____ # Smoke Detectors Needed 4 # CO Needed 1

Bath Window no Fan CFM ∅ Bath Window no Fan CFM ∅



Kitchen Window y Fan CFM ∅

Health & Safety Items Needed: _____

Dryer Vent Needed: yes

C1003648SA101

10'

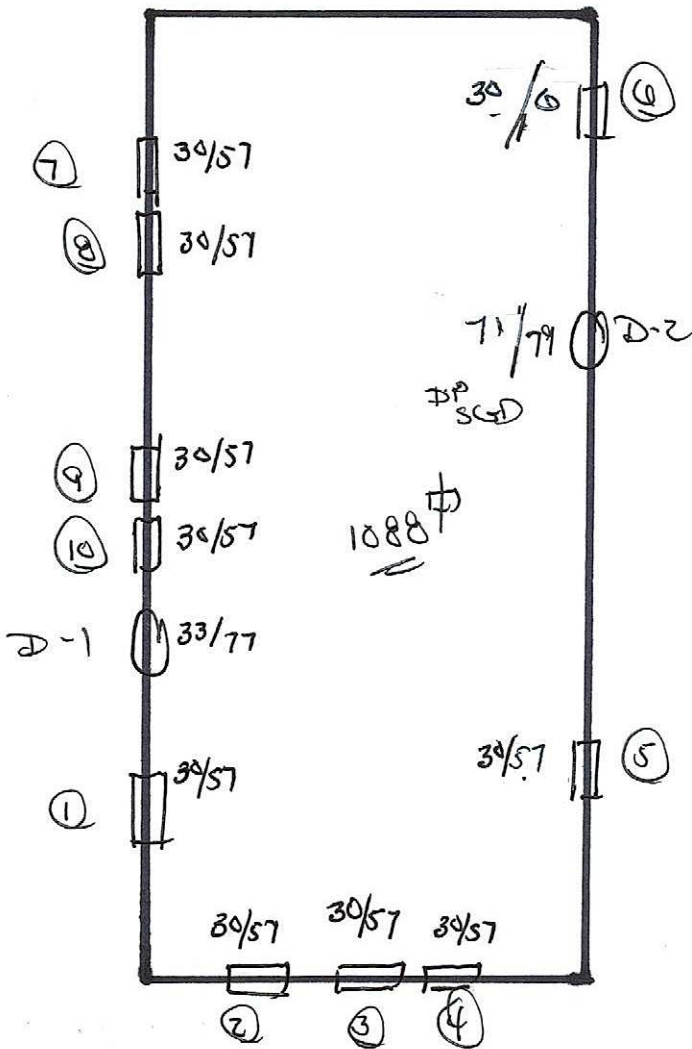

TAYLOR LN.