

Client# C10038215A101

Date: 3-10-2020

Temp 60°

Client Name \_\_\_\_\_

Address \_\_\_\_\_

Square Footage \_\_\_\_\_ Year Built 1991 # Bedrooms 2 # Bathrooms 1

Blower Door 2570 @-50 Target \_\_\_\_\_ @-50

Pressure Pans: Return 9.2 Living Room 3.9 Kitchen 4.5 Bedroom 5.0

Bedroom 5.9 Bathroom 5.7 Bedroom \_\_\_\_\_ Bathroom \_\_\_\_\_ Other \_\_\_\_\_

Heat Description: Forced Air Furnace MFG: 1989 Fuel \_\_\_\_\_

Model # FE17010H1A-04 Serial # FE178906-00473

Efficiency: 35 Kbtu

Air Conditioning Description: inop. - Goodman - central

Model # ? MFG: 1989? Serial # ?

Efficiency: < 10 SEER

Water heater: US Craftmaster R1F50R004SV PRV Pipe Needed? Yes

Refrigerator: ET18PKXDW00 Whirlpool MFG: 1995 Fair Seal

Existing Insulation: Walls 3"

Attic 1"

Floor 2.5" Fair

Vapor Barrier Needed: \_\_\_\_\_ # Smoke Detectors Needed 3 # CO Needed 1



Bath Window 4 Fan CFM 4 Bath Window \_\_\_\_\_ Fan CFM \_\_\_\_\_

Kitchen Window \_\_\_\_\_ Fan CFM \_\_\_\_\_

Health & Safety Items Needed: Junction box @ DWV Weather proof Outlet Cover - Exterior

Dryer Vent Needed: 4

C1003821SA101

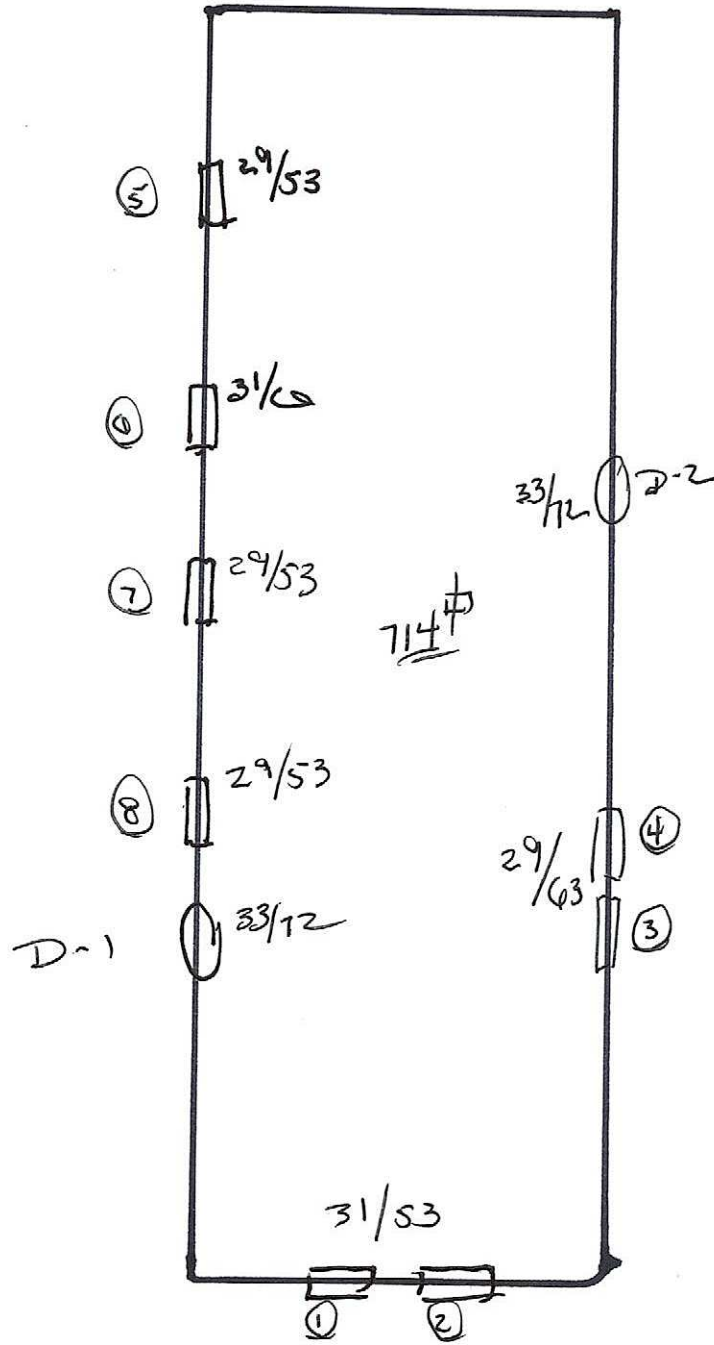

14